




# Storage Tank Detail


## The City of Oklahoma City Fire Department

**TYPICAL ABOVEGROUND WATER STORAGE TANK  
DETAIL FOR FIREFIGHTING PURPOSES**

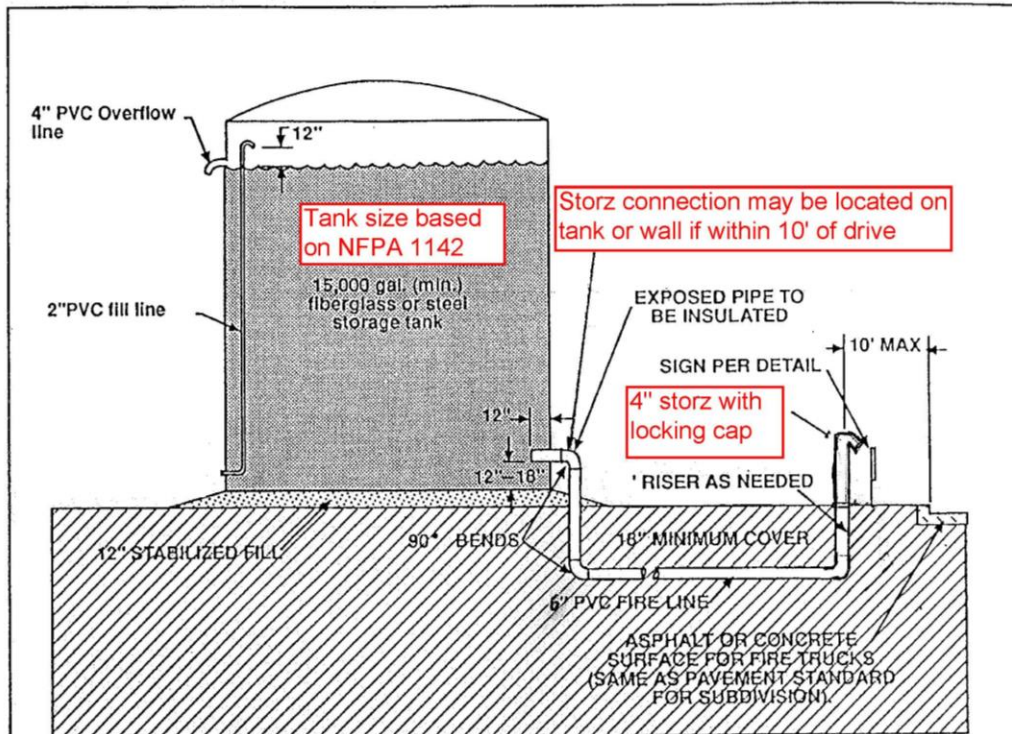

**NOTE**  
Hydrant shall be painted grey with red outlet caps and top.

An automatic means to fill and maintain the tank full must be provided.  
All structures must be within a 300' radius of the storz connection.  
Means to verify the water level in the tank must also be provided.

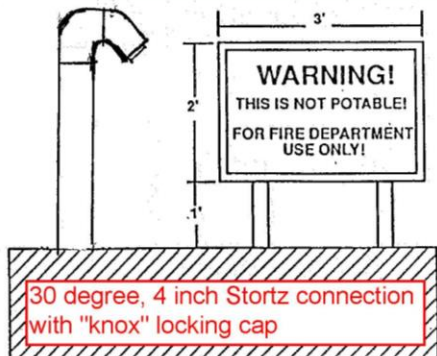

 <b>The City of OKLAHOMA CITY FIRE DEPARTMENT</b>	Storage Tank Detail
	Sheet 1 of 2 Fire Protection System to serve commercial property