


QUANTITIES		SECTION DIMENSIONS						REINFORCING STEEL																																													
PER FOOT OF BARREL								A1 BARS				A2 BARS				A3 BARS				B1 BARS				B2 BARS				C1 BARS				C2 BARS				C3 BARS				C4 BARS				E1 BARS AT 12" MAX.			E2 BARS AT 12" MAX.						
CONC. (C.Y.)	REINF. (LB.)	S	H	T	U	W	Z	SIZE	SPA.	LENGTH	WEIGHT PER FT.	SIZE	SPA.	LENGTH	WEIGHT PER FT.	SIZE	SPA.	LENGTH	WEIGHT PER FT.	SIZE	SPA.	"X" (HORIZ.)	"Y" (VERT.)	LENGTH	WEIGHT PER FT.	SIZE	SPA.	"X" (HORIZ.)	"Y" (VERT.)	LENGTH	WEIGHT PER FT.	SIZE	SPA.	LENGTH	WEIGHT PER FT.	SIZE	SPA.	LENGTH	WEIGHT PER FT.	SIZE	SPA.	LENGTH	WEIGHT PER FT.	NO.	SIZE	WEIGHT PER FT.	NO.	SIZE	WEIGHT PER FT.				
1.73	216.9	9'	3'	11"	12"	10"	10"	#4	6"	20'-2"	53.9	#4	12"	20'-2"	26.9	#5	12"	4'-4"	9.0	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	1'-11"	3'-9"	5'-8"	15.1	#4	6"	2'-4"	6.2	#4	6"	3'-9"	10.0	#4	12"	2'-4"	3.1	#4	12"	3'-9"	5.0	96	#4	64.1	18	#4	12.0
1.83	227.8	9'	4'	11"	12"	10"	10"	#4	6"	20'-2"	53.9	#4	12"	20'-2"	26.9	#5	12"	4'-5"	9.2	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	1'-11"	4'-9"	6'-8"	17.8	#4	6"	2'-4"	6.2	#4	6"	4'-9"	12.7	#4	12"	2'-4"	3.1	#4	12"	4'-9"	6.3	96	#4	64.1	24	#4	16.0
1.92	247.8	9'	5'	11"	12"	10"	10"	#4	6"	20'-2"	53.9	#4	12"	20'-2"	26.9	#6	12"	6'-2"	18.5	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	1'-11"	5'-9"	7'-8"	20.5	#4	6"	2'-4"	6.2	#4	6"	5'-9"	15.4	#4	12"	2'-4"	3.1	#4	12"	5'-9"	7.7	96	#4	64.1	30	#4	20.0
2.01	288.9	9'	6'	11"	12"	10"	10"	#5	6"	20'-2"	84.1	#4	12"	20'-2"	26.9	#6	12"	6'-3"	18.8	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	1'-11"	6'-9"	8'-8"	23.2	#4	6"	2'-4"	6.2	#4	6"	6'-9"	18.0	#4	12"	2'-4"	3.1	#4	12"	6'-9"	9.0	96	#4	64.1	36	#4	24.0
2.10	299.6	9'	7'	11"	12"	10"	10"	#5	6"	20'-2"	84.1	#4	12"	20'-2"	26.9	#6	12"	6'-3"	18.8	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	1'-11"	7'-9"	9'-8"	25.8	#4	6"	2'-4"	6.2	#4	6"	7'-9"	20.7	#4	12"	2'-4"	3.1	#4	12"	7'-9"	10.4	96	#4	64.1	42	#4	28.1
2.29	312.4	9'	8'	11"	12"	11"	11"	#5	6"	20'-5"	85.2	#4	12"	20'-5"	27.3	#6	12"	6'-4"	19.0	#4	6"	1'-11"	2'-4"	4'-3"	11.4	#4	6"	2'-0"	8'-9"	10'-9"	28.7	#4	6"	2'-4"	6.2	#4	6"	8'-9"	23.4	#4	12"	2'-4"	3.1	#4	12"	8'-9"	11.7	96	#4	64.1	48	#4	32.1
2.39	323.8	9'	9'	11"	12"	11"	11"	#5	6"	20'-5"	85.2	#4	12"	20'-5"	27.3	#6	12"	6'-5"	19.3	#4	6"	2'-11"	2'-4"	4'-5"	11.8	#4	6"	2'-11"	9'-9"	11'-10"	31.6	#4	6"	2'-4"	6.2	#4	6"	9'-9"	26.1	#4	12"	2'-4"	3.1	#4	12"	9'-9"	13.0	96	#4	64.1	54	#4	36.1
1.88	303.8	10'	3'	11"	12"	10"	10"	#5	6"	22'-2"	92.5	#4	12"	22'-2"	29.6	#6	12"	6'-7"	19.8	#5	6"	2'-2"	2'-9"	4'-11"	20.5	#5	6"	2'-2"	3'-9"	5'-11"	24.7	#5	6"	2'-9"	11.5	#5	6"	3'-9"	15.6	#4	12"	2'-4"	3.1	#4	12"	3'-9"	5.0	104	#4	69.5	18	#4	12.0
1.97	305.1	10'	4'	11"	12"	10"	10"	#5	6"	22'-2"	92.5	#4	12"	22'-2"	29.6	#6	12"	6'-7"	19.8	#5	6"	2'-2"	2'-9"	4'-11"	20.5	#5	6"	2'-2"	4'-9"	6'-11"	28.9	#4	6"	2'-4"	6.2	#4	6"	4'-9"	12.7	#4	12"	2'-4"	3.1	#4	12"	4'-9"	6.3	104	#4	69.5	24	#4	16.0
2.06	325.8	10'	5'	11"	12"	10"	10"	#5	6"	22'-2"	92.5	#4	12"	22'-2"	29.6	#7	12"	6'-11"	28.3	#5	6"	2'-2"	2'-9"	4'-11"	20.5	#5	6"	2'-2"	5'-9"	7'-11"	33.0	#4	6"	2'-4"	6.2	#4	6"	5'-9"	15.4	#4	12"	2'-4"	3.1	#4	12"	5'-9"	7.7	104	#4	69.5	30	#4	20.0
2.15	338.0	10'	6'	11"	12"	10"	10"	#5	6"	22'-2"	92.5	#4	12"	22'-2"	29.6	#7	12"	6'-11"	28.3	#5	6"	2'-2"	2'-9"	4'-11"	20.5	#5	6"	2'-2"	6'-9"	8'-11"	37.2	#4	6"	2'-4"	6.2	#4	6"	6'-9"	18.0	#4	12"	2'-4"	3.1	#4	12"	6'-9"	9.0	104	#4	69.5	36	#4	24.0
2.33	352.6	10'	7'	11"	12"	11"	11"	#5	6"	22'-5"	93.5	#4	12"	22'-5"	29.9	#7	12"	7'-0"	28.6	#5	6"	2'-3"	2'-9"	5'-0"	20.9	#5	6"	2'-3"	7'-9"	10'-0"	41.7	#4	6"	2'-4"	6.2	#4	6"	7'-9"	20.7	#4	12"	2'-4"	3.1	#4	12"	7'-9"	10.4	104	#4	69.5	42	#4	28.1
2.43	364.8	10'	8'	11"	12"	11"	11"	#5	6"	22'-5"	93.5	#4	12"	22'-5"	29.9	#7	12"	7'-0"	28.6	#5	6"	2'-3"	2'-9"	5'-0"	20.9	#5	6"	2'-3"	8'-9"	11'-0"	45.9	#4	6"	2'-4"	6.2	#4	6"	8'-9"	23.4	#4	12"	2'-4"	3.1	#4	12"	8'-9"	11.7	104	#4	69.5	48	#4	32.1
2.53	377.3	10'	9'	11"	12"	11"	11"	#5	6"	22'-5"	93.5	#4	12"	22'-5"	29.9	#7	12"	7'-1"	29.0	#5	6"	2'-3"	2'-9"	5'-0"	20.9	#5	6"	2'-3"	9'-9"	12'-0"	50.1	#4	6"	2'-4"	6.2	#4	6"	9'-9"	26.1	#4	12"	2'-4"	3.1	#4	12"	9'-9"	13.0	104	#4	69.5	54	#4	36.1
2.74	404.7	10'	10'	11"	12"	12"	12"	#5	6"	22'-8"	94.6	#4	12"	22'-8"	30.3	#7	12"	7'-2"	29.3	#5	6"	2'-7"	2'-9"	5'-4"	22.3	#5	6"	2'-7"	10'-9"	13'-4"	55.6	#4	6"	2'-4"	6.2	#4	6"	10'-9"	28.7	#5	12"	2'-9"	5.7	#5	12"	10'-9"	22.4	104	#4	69.5	60	#4	40.1


NOTE:  
A, B AND C BARS ARE CENTERED PER L.F. OF BARREL LENGTH.  
FOR 0 SKEW END SECTIONS, ADJUST BAR QUANTITIES AS SHOWN  
ON END SECTION DETAILS, SHEET 2 OF 2. NO ADJUSTMENT IS  
REQUIRED FOR 30 DEGREE SKEW END SECTIONS.

BASIS OF PAYMENT		
CODE	DESCRIPTION	UNIT
404-00	STRUCTURAL CONCRETE	C.Y.
411-00	REINFORCING STEEL	LBS.
982	PIPE RAILING	L.F.

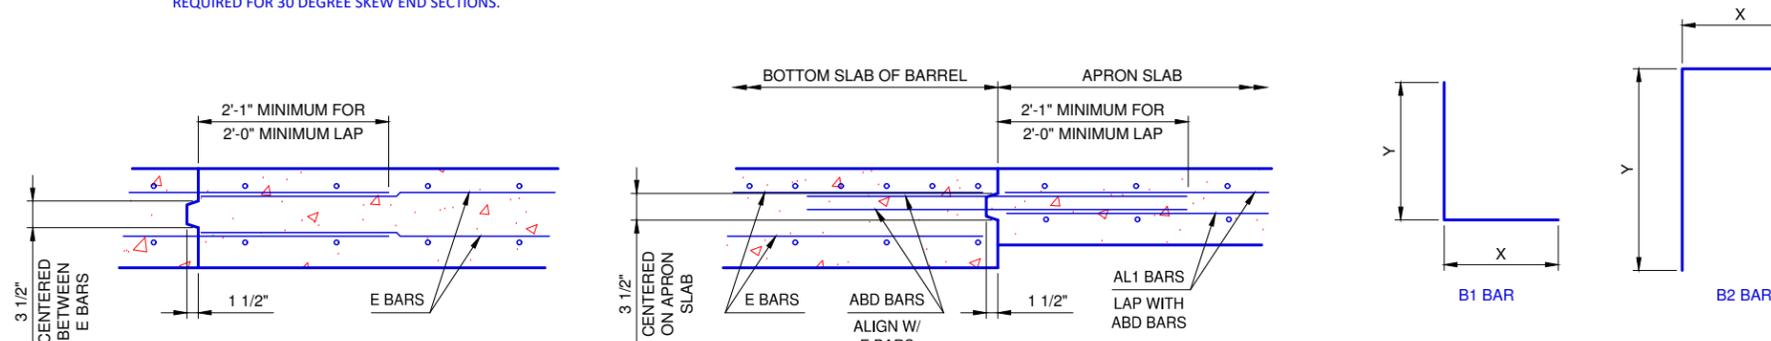

TRANSVERSE CONSTRUCTION JOINT

CONSTRUCTION JOINT BETWEEN BARREL AND APRON

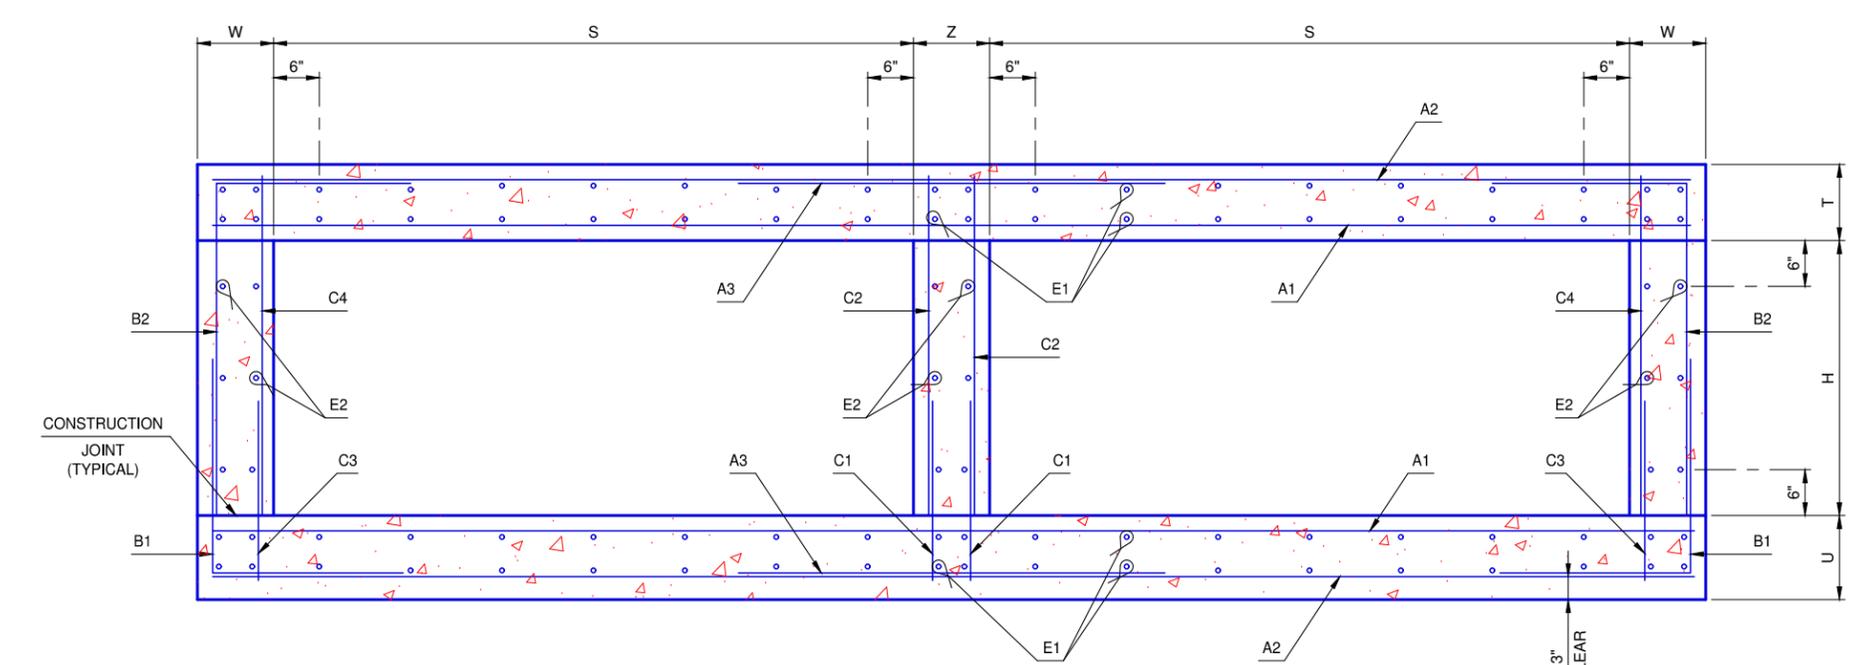

TYPICAL BARREL SECTION

NOTE:  
SEE SCHEDULE ON THIS SHEET FOR ACTUAL NUMBER AND SPACING OF E1 AND E2 BARS.

**DESIGN DATA**  
CLASS AA CONCRETE  $f_c = 4$  K.S.I.  
REINFORCING STEEL  $f_y = 60$  K.S.I.

**LOADING -**  
HL-93 LOADING OR OKLAHOMA DEPARTMENT OF TRANSPORTATION OVERLOAD TRUCK  
H-20 TRUCK  
HS-20 TRUCK  
TYPE 3-3 (SPECIAL HAULING VEHICLE)  
EV3 (TANDEM REAR AXLE EMERGENCY VEHICLE)  
SHV NRL (SPECIAL HAULING VEHICLE NOTIONAL RATING LOAD)  
ALL LOAD VEHICLES LISTED, EXCEPT HL-93 AND OKLAHOMA DEPARTMENT OF TRANSPORTATION OVERLOAD TRUCK, WERE ANALYZED USING LOAD FACTOR DESIGN (LFD).

**DESIGN -**  
AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 9TH EDITION  
AASHTO MANUAL FOR BRIDGE EVALUATION, 3RD EDITION, 2018, WITH 2019 INTERIM REVISIONS

**R.C.B. GENERAL NOTES**  
COMPLY WITH THE REQUIREMENTS OF THE CURRENT THE CITY OF OKLAHOMA CITY STANDARD SPECIFICATIONS.  
PROVIDE A 1 1/2" CHAMFER ON ALL EXPOSED CONCRETE EDGES. USE SIZED LUMBER FOR ALL CHAMFER STRIPS.  
PROVIDE 2" MINIMUM CLEAR COVER FOR ALL REINFORCING STEEL UNLESS NOTED OTHERWISE.  
PLACE TRANSVERSE CONSTRUCTION JOINTS IN ALL CULVERTS 100 FT. OR MORE IN LENGTH AT A MAXIMUM SPACING OF 60 FT. SUBMIT LOCATIONS TO THE CITY ENGINEER FOR APPROVAL. SEE TRANSVERSE CONSTRUCTION JOINT DETAIL ON THIS SHEET.  
THE QUANTITY FOR REINFORCING STEEL OF E1 AND E2 BARS DOES NOT INCLUDE LAP SPLICES IN THE LENGTH OF THE BARREL OR AT TRANSVERSE CONSTRUCTION JOINTS WITHIN THE BARREL. COSTS FOR SPLICES WILL NOT BE MEASURED FOR PAYMENT AND WILL BE INCLUDED IN THE CONTRACT UNIT PRICE FOR REINFORCING STEEL.  
PIPE RAILING REQUIRED ON TOP OF HEADWALL AND WINGWALLS. SEE STD. RCB-015 PipeRailing.

PLACE WD AND ABD BARS FOR WINGWALLS AND APRON TIED TO BARREL REINFORCING BEFORE PLACING BARREL CONCRETE

REVISION NO.
DATE

APPROVED BY: DATE: 6/22/2023  
ERIC J. WENGER, P.E.  
CITY ENGINEER  
THESE STANDARD DRAWINGS AND ASSOCIATED CALCULATIONS HAVE BEEN PREPARED BY CEC CORPORATION UNDER CONTRACT WITH THE CITY OF OKLAHOMA CITY.

R.C.B. CULVERTS - BARREL DETAILS  
9' AND 10' SPANS - DOUBLE CELL  
2' TO 10' FILL

Drawing Number  
RCB-009

The City of Oklahoma City  
Public Works Department  
Engineering Division